


Temperature and humidity transmitter TH 100

- Humidity and temperature transmitter type TH100.
- Measuring ranges 0-100%RH and -50 to +50°C, -20 to +80°C, 0 to +50°C, 0 to +100°C (see "Configuration")
- 0-10 V output, active sensor, power supply 24 Vac/Vdc (3-4wires) or 4-20 mA output, passive loop, power supply 18 to 30 Vdc (2 wires).
- Housing ABS IP 65 with or without display.
- Alternating display of humidity and temperature
- Quick and easy mounting "1/4 turn" system on wall-mount plate.

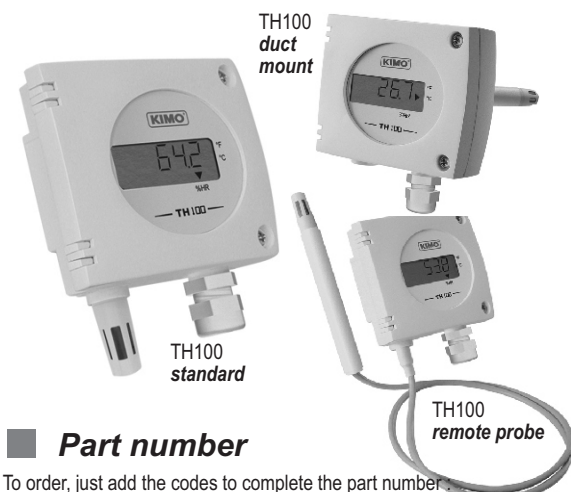

Part number

To order, just add the codes to complete the part number:

Transmitter / Power supply / Output

V	Active • 24 Vac/Vdc • 0-10V
A	Passive • 18/30 Vdc • 4-20 mA

Display

O	With display
N	Without display

Probe

S	Standard
A	Duct mount
D	Remote

TH100 - [] [] [] []


Example : TH100-VOD

Model : temperature and humidity transmitter TH 100, active sensor, 0-10 V output, with display and remote probe.


Dimensions of the housing

(including the wall-mount plate)


Standard

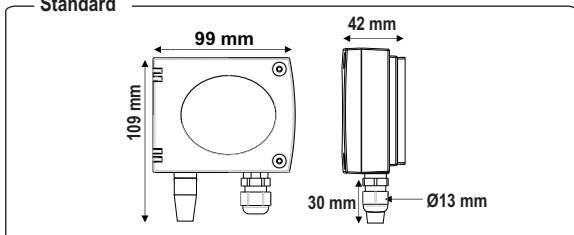

Duct mount

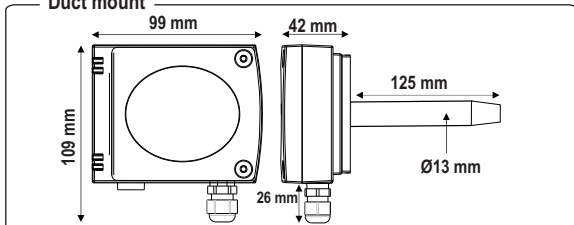

Remote

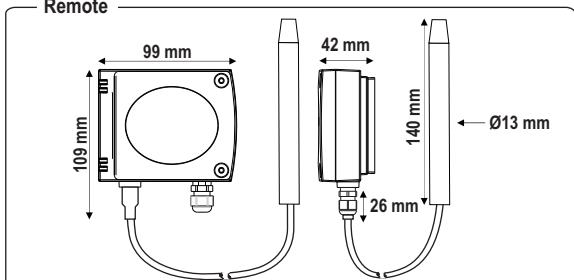

Features of the transmitter

Humidity

Working principle : the measurement of temperature and humidity is made by only one digital component CMOS (complementary metal-oxide semiconductor), including a capacitive element and a thermistor. This technology guarantees an excellent stability in the long term, along with a great accuracy of the measurement.

Measuring range 0 to 100 % RH

Accuracy* Accuracy (Repeatability, linearity, hysteresis)**: ±2%RH (from 15 to 25°C)
Factory calibration uncertainty : ±0.88%RH
Temperature dependence : ±0.04 x (T-20)%RH (if T<15°C or T>25°C)

Unit of measurement % RH

Response time 1/e (63%) 4 s

Resolution 0,1% RH

Type of fluid air and neutral gases

*All accuracies indicated in this technical datasheet were stated in laboratory conditions, and can be guaranteed for measurements carried out in the same conditions, or carried out with calibration compensation.

**As per NFX 15-113 and the Charter 2000/2001 HYGROMETERS, GAL (Guaranteed Accuracy Limit) which has been calculated with a coverage factor value of 2 is ±2.98%RH between 18 and 28°C on the measuring range from 3 to 98%RH. Sensor drift is less than 1%RH/year.

Temperature

Measuring range 0 to +50°C, -20 to +80°C, -50 to +50°C, 0 to +100°C

Unit of measurement °C, °F

Accuracy * from -20 to 0°C : ±2% of reading ±0.6°C
from 0 to 30°C : 0.5°C
from 30 to 80°C : 1.5% of reading

Response time 1/e (63%) 15 s

Resolution 0,1°C

Type of fluid air and neutral gases

*All the accuracies indicated in this technical datasheet were stated in laboratories conditions, and can be guaranteed for measurements carried out in the same conditions, or carried out with calibration compensation.

Features of the housing

Housing ABS

Fire-proof classification HB as per UL94

Dimensions see drawing beside

Protection IP65

Display 5-digit LCD. Dimensions 50 x 15 mm
Alternating display of humidity and temperature.

Height of the digits 10 mm

Cable gland for cable Ø 8 mm maxi.

Weight 151 g (with display) - 116 g (without display)

WITH or WITHOUT display



Technical Specifications


Output / Power supply.....active 0-10 V (power supply 24 Vac/Vdc $\pm 10\%$), 3-4 wires
 passive loop 4-20 mA (power supply 18/30 Vdc), 2 wires
 maximum load : 500 Ohms (4-20 mA)
 minimum load : 1 K Ohms (0-10 V)
Consumption.....2 VA (0-10V) or max. 22 mA (4-20 mA)
Electro-magnetical compatibility ...EN 61326
Electrical connection.....screw terminal block for cable \varnothing 1.5 mm²
 max.

Communication to PC..... Kimo RS 232 cable
Working temperature(housing)0 to +50°C
Working temperature (probe).....0 to +50°C (standard)
 -20 to +80°C (remote and duct mount)
Storage temperature.....-10 to +70°C
Environment.....air and neutral gases
Warm up time30 minutes

Connection

For the models

TH 100 - AOS, TH100 - ANS, TH 100 - AOD, TH 100 - AND, TH 100 - AOA, TH 100 - ANA • Output 4-20 mA - **passive loop**

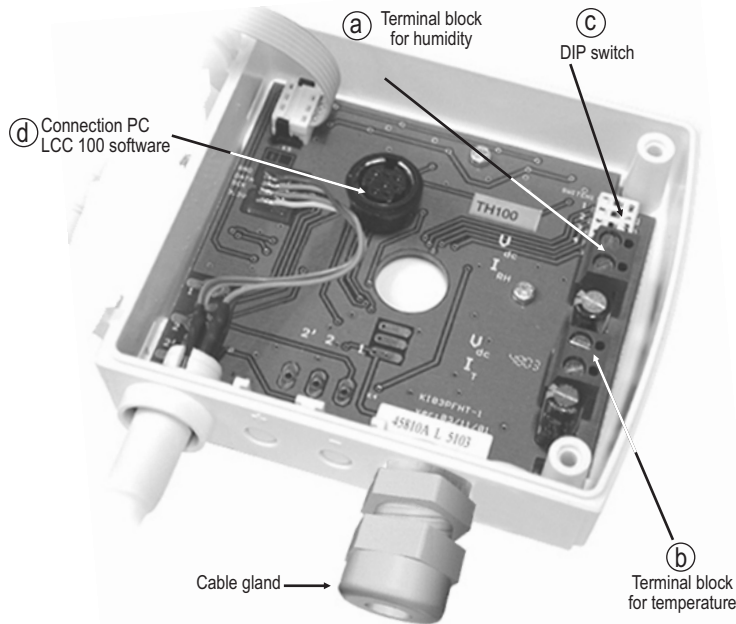

- (a) $\begin{matrix} \text{Vdc} & \dots\dots & \text{direct voltage} \\ \text{IRH} & \dots\dots & \text{direct current (humidity)} \end{matrix}$
 (b) $\begin{matrix} \text{Vdc} & \dots\dots & \text{direct voltage} \\ \text{IT} & \dots\dots & \text{direct current (temperature)} \end{matrix}$

For the models

TH 100 - VOS, TH100 - VNS, TH 100 - VOD, TH 100 - VND, TH 100 - VOA, TH 100 - VNA • Output 0-10 V - **active**


- (a) $\begin{matrix} \text{Vdc RH} & \dots\dots & \text{direct voltage (humidity)} \\ \text{GND} & \dots\dots & \text{ground} \\ \text{Vdc T} & \dots\dots & \text{direct voltage (temperature)} \end{matrix}$

Power supply

- (b) $\begin{matrix} \text{Vdc} & \dots\dots & \text{direct voltage} \\ \text{GND} & \dots\dots & \text{ground} \end{matrix}$

OR

- (b) $\begin{matrix} \text{Vac} & \dots\dots & \text{alternative voltage (phase)} \\ \text{Vac} & \dots\dots & \text{alternative voltage (neutral)} \end{matrix}$

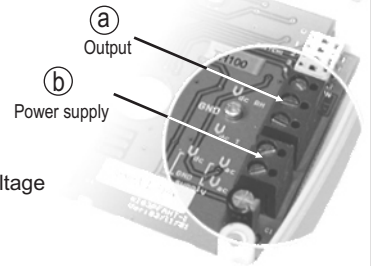


Electrical connection - as per norm NFC15-100

! This connection must be made by a qualified technician. To make the connection, the transmitter must not be energized.


For the models

TH 100 - AOS, TH100 - ANS, TH 100 - AOD, TH 100 - AND, TH 100 - AOA, TH 100 - ANA • Output 4-20 mA - **passive**

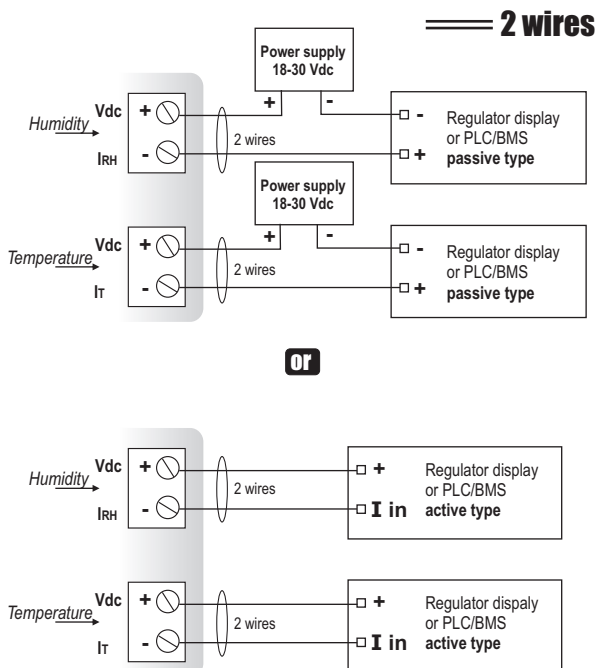

For the models

TH 100 - VOS, TH100 - VNS, TH 100 - VOD, TH 100 - VND, TH 100 - VOA, TH 100 - VNA • Output 0-10 V - **active**

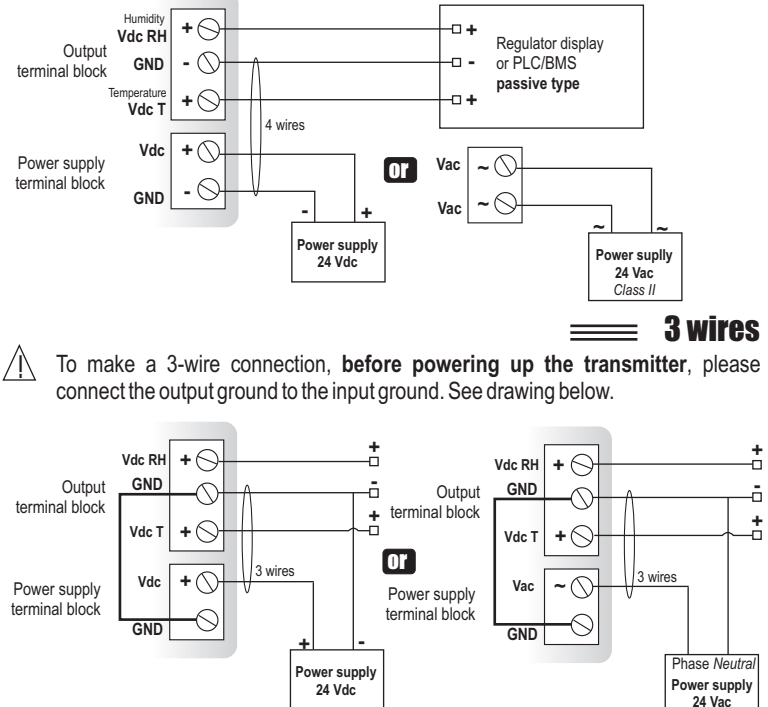



! To make a 3-wire connection, before powering up the transmitter, please connect the output ground to the input ground. See drawing below.

Configuration


It is possible to configure the measuring ranges, the units, the output of the transmitter (according to the model) either by **DIP switch** and/or via **software** (connections ③ and ④ on drawing "connection").

Configuration by DIP switch

To configure the instrument, please unscrew the 2 screws from the housing, and then open it.

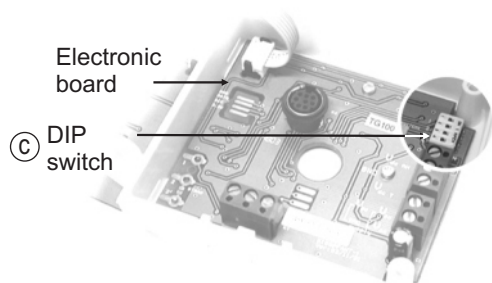

Identification of the DIP switches on the electronic card



To configure the transmitter, it **must not be energized**. Then, you can make the settings required, with the DIP switches (as shown on the drawing beside). When the transmitter is configured, you can power it up.



Caution !

Please follow carefully the combinations beside with the DIP switch.

If the combination are wrongly done, the following message will appear on the display of the transmitter "CONF ERROR". In that case, you will have to unplug the transmitter, replace the DIP switches correctly, and then power the transmitter up.

Units setting

To set the measuring unit, put the on-off switch 4 of units as shown beside.

Configurations	°C	°F
Combinations	1	1
	2	2
	3	3
	4	4

Measuring range setting

To set the measuring range, put the on-off switches 1, 2 and 3 of the measuring range as shown beside.

Configurations	0 to 50 °C	-20 to 80 °C	-50 to 50 °C	0 to 100 °C
Combinations	1	1	1	1
	2	2	2	2
	3	3	3	3
	4	4	4	4

Initialization the transmitter

When the transmitter is powered up, it initializes and displays the digits and then its configuration including :
 - the measuring range
 - the analog output.

1- The measuring range

The following message is displayed : . This is the low value of the measuring range, and its digit value : **ex** : .
 The following message is displayed : . This is the high value of the measuring range and its digit value : **ex** : .
 The arrow displayed (at the bottom or on the right of the screen) is relative to the unit of measurement : **ex** : from 0 to 100 %RH.

2 - The analog output

If the analog output is in 4-20mA, then the following message will appear .
 If the analog output is 0-10 V, then the following message will appear .

The transmitter can measure several parameters (TH 100 => humidity + temperature). The transmitter will first display the configuration of humidity parameters, and secondly the configuration of temperature parameters.

After the display of the configurations, the transmitter displays , which confirms that the initialization is finished and you can start the measurements.

■ Configuration by **software** (LCC100 coming in option)


An easy and friendly configuration with the software !

You can configure your own intermediary ranges, the offset...


Example :

- For a transmitter from 0-100°C, the minimum delta of the range is 20°C. You can also configure your transmitter from 0 to +70°C, or from -10 to +10°C...
- In order to avoid any eventual drift of the transmitter, you can add an offset to the value displayed by the TH 100. For example : the TH100 displays 48%RH, a standard instrument displays 45%RH. Then, you can integrate an offset of -3 to the value displayed by the TH 100, thanks to the LCC100 software.

To have access to the configuration with software, **first of all**, it is required to **set the DIP switch as shown below**, then to connect the cable to the transmitter (see beside and see "Connection").
To make the configuration, please refer to the user manual of the LCC 100.



DIP switch



Caution !


The configuration of the parameters can be done **either by DIP switch, OR by software** (you cannot combine both solutions).

■ Mounting

To make the wall-mounting, install the ABS plate onto the wall (this plate is supplied with the transmitter). Drilling : Ø 6 mm (with the screws and pins supplied with the transmitter).

Insert the transmitter on the plate (see A on the drawing beside) and make its housing rotated in clockwise direction till you hear a "click", which confirms that the transmitter is correctly installed).

For the model with duct want an additional drilling of Ø 14 mm must be done.

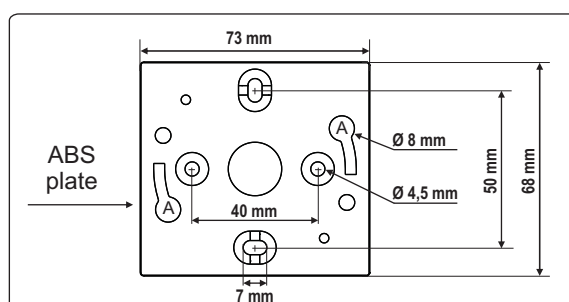

■ Maintenance

Please avoid any aggressive solvent.

Please protect the transmitter and its probes from any cleaning product containing formol, that may be used for cleaning rooms or ducts.

■ Options

- Power supply class 2, input 230 Vac, output 24 Vac, ref.KIAL-100A
- Configuration software LCC 100 with cable RS 232



■ Accessories

- Stainless steel connection
- PC connection gland
- ABS connection with connection gland
- Stainless steel connections
- Wall-mount plate for humidity remote probe